


- NOTE:**
1. HDPE PIPE 4-INCH AND LARGER, USE HDPE FLANGE ADAPTERS, WHERE FLANGE CONNECTIONS OCCUR.
 2. HDPE PIPE 3-INCH AND SMALLER, USE HDPE THREADED UNIONS IN PLACE OF FLANGES.
 3. TRENCH RESURFACING SHALL CONFORM TO SDRSD, G-24A AND G-24B. THE FINAL SURFACE TREATMENT SHALL MATCH EXISTING SURFACE TYPE.

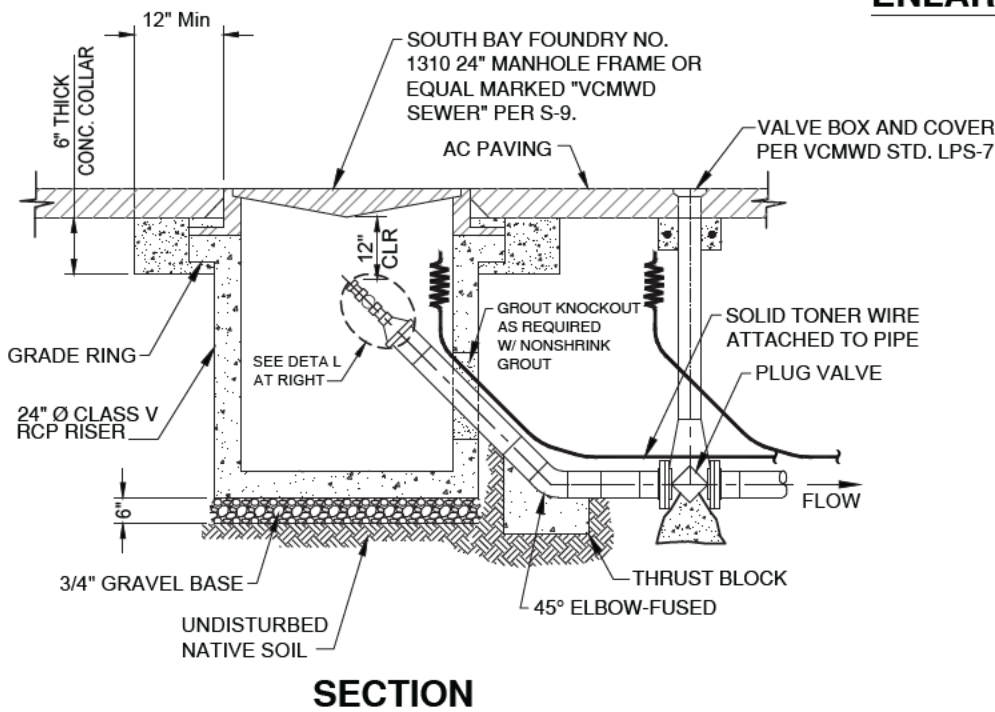

APPROVED:
Walter A. ... 3/2/2020
 District Engineer Date
 3/2/2020
 Latest Revision Date

VALLEY CENTER MUNICIPAL WATER DISTRICT
 STANDARD DRAWING
LOW PRESSURE CLEANOUT

NOT TO SCALE
 DWG. NUMBER
LPS-4