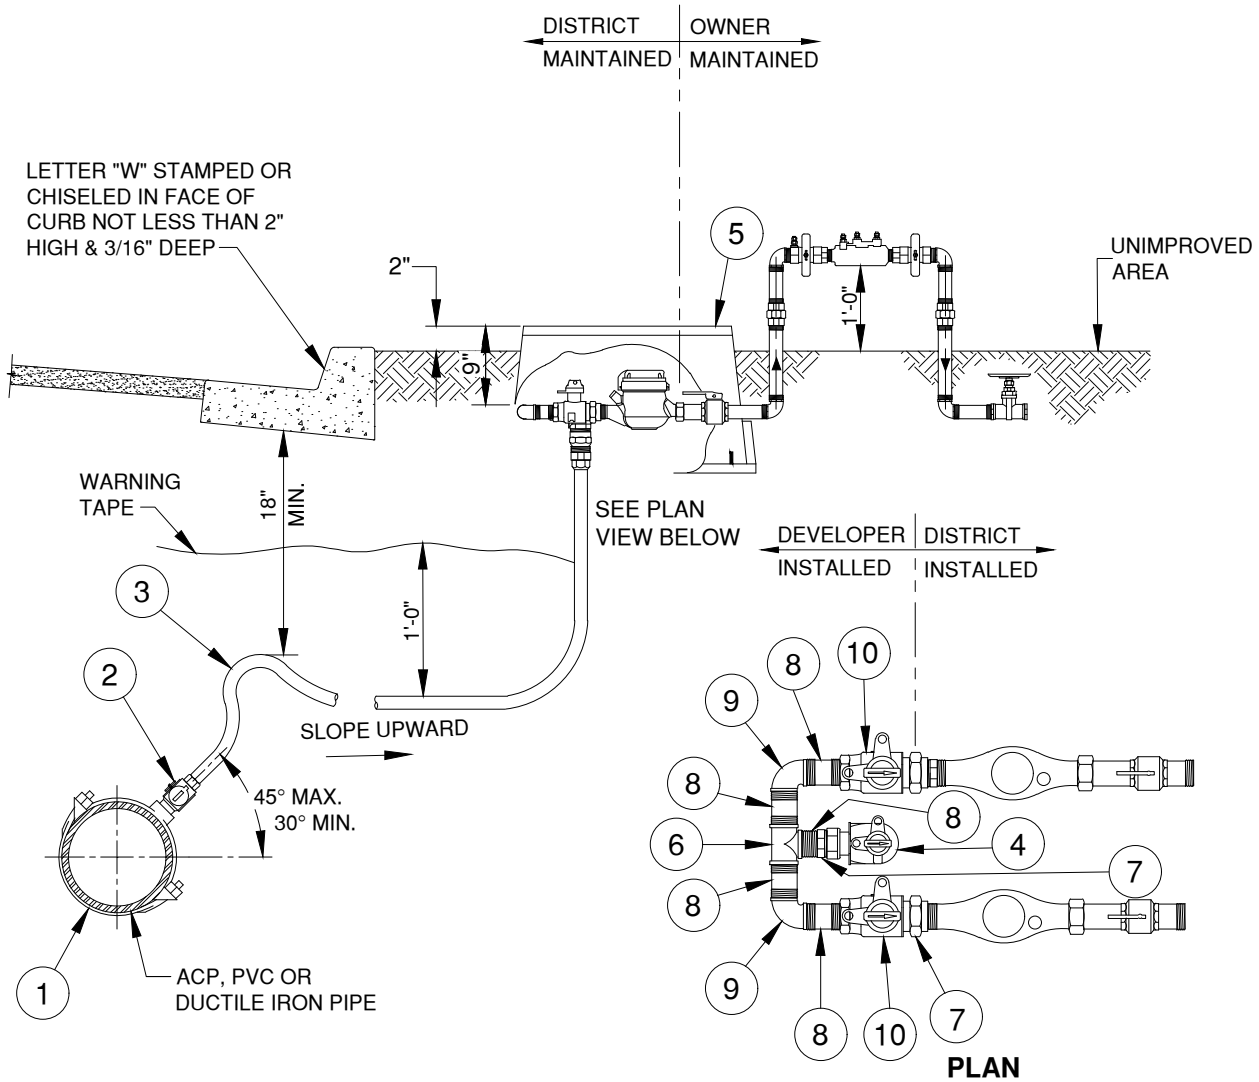

PLAN

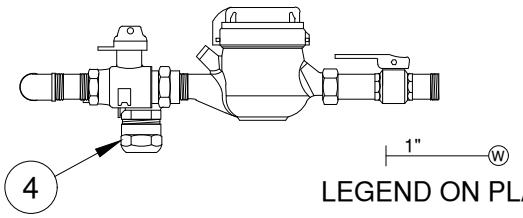

LEGEND ON PLANS

NOTE:

1. FOR THE LOCATION OF APPURTENANCES SEE STANDARD DRAWING NO. W-2
2. DISTRICT INSTALLED BACKFLOW AREA TO REMAIN CLEAR.

NO.	DESCRIPTION	NO.	DESCRIPTION
1	MAIN SIZE x SERVICE SIZE, BRONZE DOUBLE STRAP SADDLE FOR ACP & DIP, SS DOUBLE STRAP FOR PVC	8	1" x SHORT BRASS NIPPLE
2	BRONZE BALL CORPORATION STOP M.I.P. x COMP (OPERATING NUT TO BE POSITIONED ON RIGHT SIDE)	9	1" 90° BRASS ELBOW
3	COPPER TUBING x REQUIRED LENGTH x SERVICE SIZE, TYPE K SOFT COPPER	10	STRAIGHT BALL METER STOP w/LOCKWING (1" F.N.P.T BY METER SWIVEL)
4	BRONZE BALL ANGLE METER STOP w/LOCKWING (1" COMP x METER SWIVEL)	11	NOT USED
5	PLASTIC METER BOX	12	NOT USED
6	1" TEE	13	NOT USED
7	1" x 1 1/4" FIRE METER BUSHING	14	NOT USED

APPROVED:

Wally Grode 1/24/22

District Engineer **Date**

1/24/22

Latest Revision Date

VALLEY CENTER MUNICIPAL WATER DISTRICT
STANDARD DRAWING

3/4" DOMESTIC & 1" FIRE WATER SERVICE

NOT TO SCALE

DWG. NUMBER

W-3A