


**NOTES:**

1. FOR LOCATION OF APPURTENANCES SEE STANDARD DRAWING NO. W-2.
2. MARKER POSTS OMITTED FOR CLARITY.

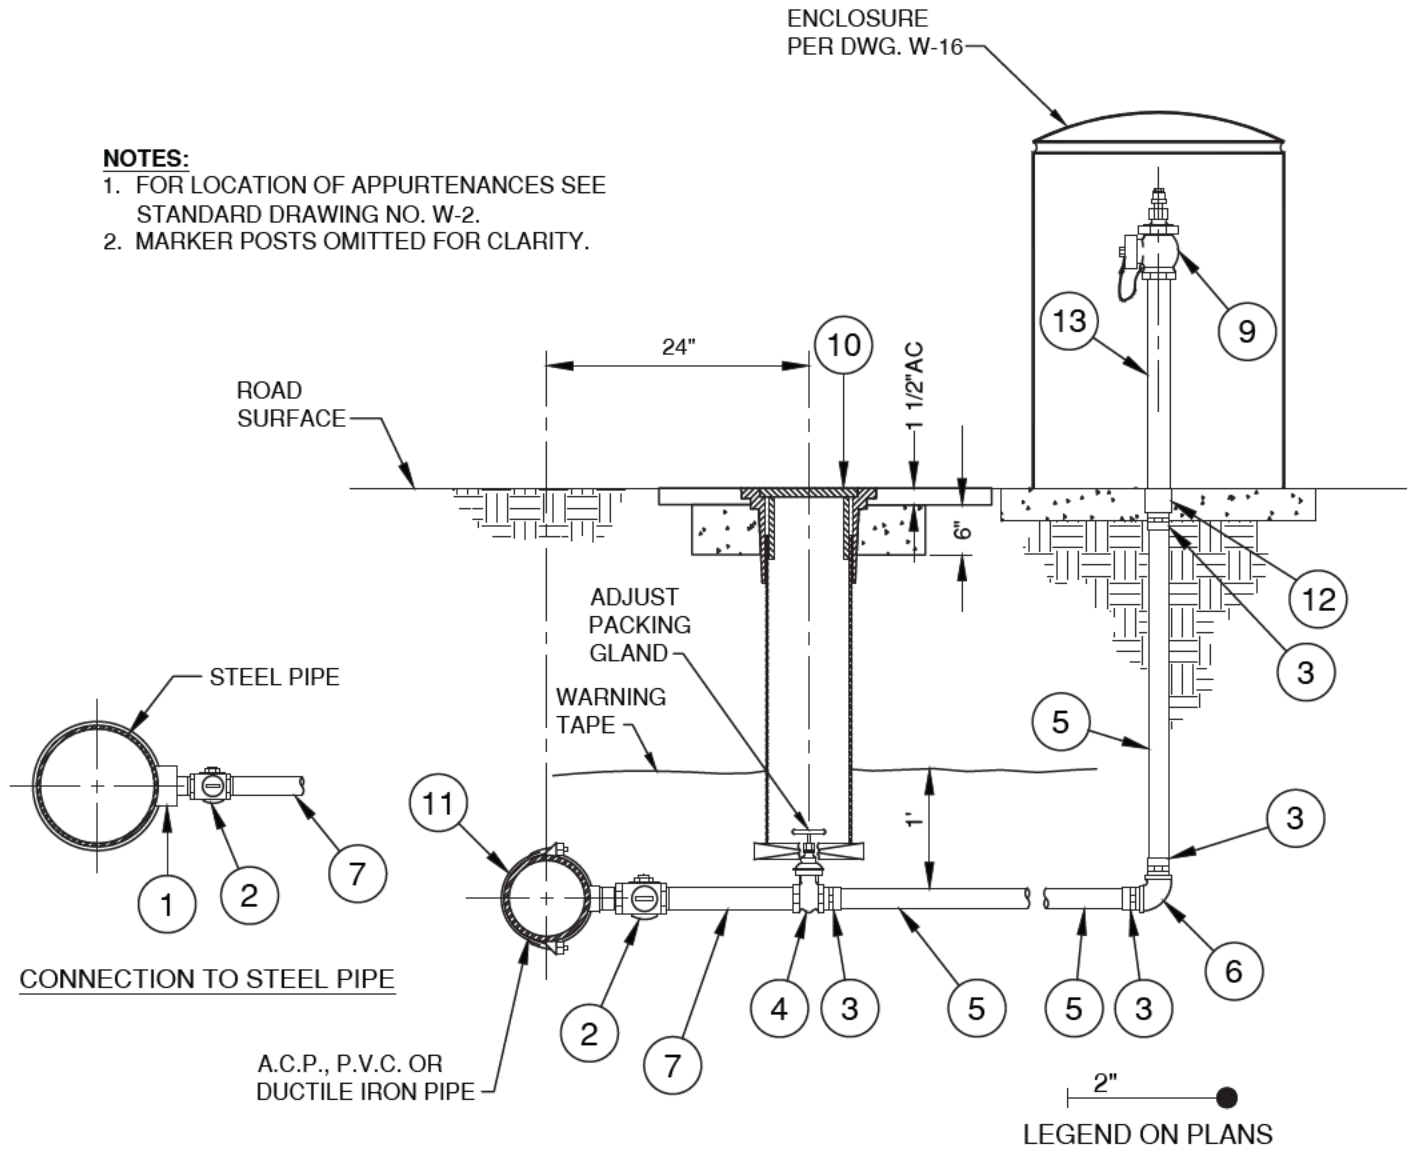

NO.	DESCRIPTION	NO.	DESCRIPTION
1	FORGED STEEL HIGH PRESSURE 1/2 COUPLING	8	RED BRASS PIPE x REQUIRED LENGTH
2	2" BRONZE BALL CORPORATION STOP M.I.P. x F.I.P. (OPERATING NUT TO BE ON THE RIGHT SIDE)	9	2" x 2 1/2" ANGLE FIRE PLUG VALVE
3	COPPER SWEAT ADAPTOR x M.I.P. THREAD	10	VALVE WELL FRAME, ASSEMBLY AND COVER PER W-25
4	BRONZE GATE VALVE W/ BRONZE HANDWHEEL, F.I.P. x F.I.P. THREAD	11	BRONZE DOUBLE STRAP SADDLE MAIN SIZE x SERVICE SIZE
5	COPPER TUBING x REQUIRED LENGTH	12	2" BRASS COUPLING, EMBEDDED FLUSH W/PAD
6	90° BRONZE F.I.P. x F.I.P. THREAD	13	2" RED BRASS NIPPLE x 18" LONG
7	2" RED BRASS PIPE x REQUIRED LENGTH		

APPROVED:  
*Wally [Signature]* 3/2/2020  
 District Engineer Date  
 3/2/2020  
 Latest Revision Date

VALLEY CENTER MUNICIPAL WATER DISTRICT  
 STANDARD DRAWING  
**2" BLOW OFF ASSEMBLY**

NOT TO SCALE  
 DWG. NUMBER  
**W-9**