


AT-GRADE TEST BOX, SEE DWG W-39 FOR TEST BOX LOCATION REQUIREMENTS

SEE ENLARGEMENT BELOW
SEE DWG W-42 FOR TEST BOX MOUNTING

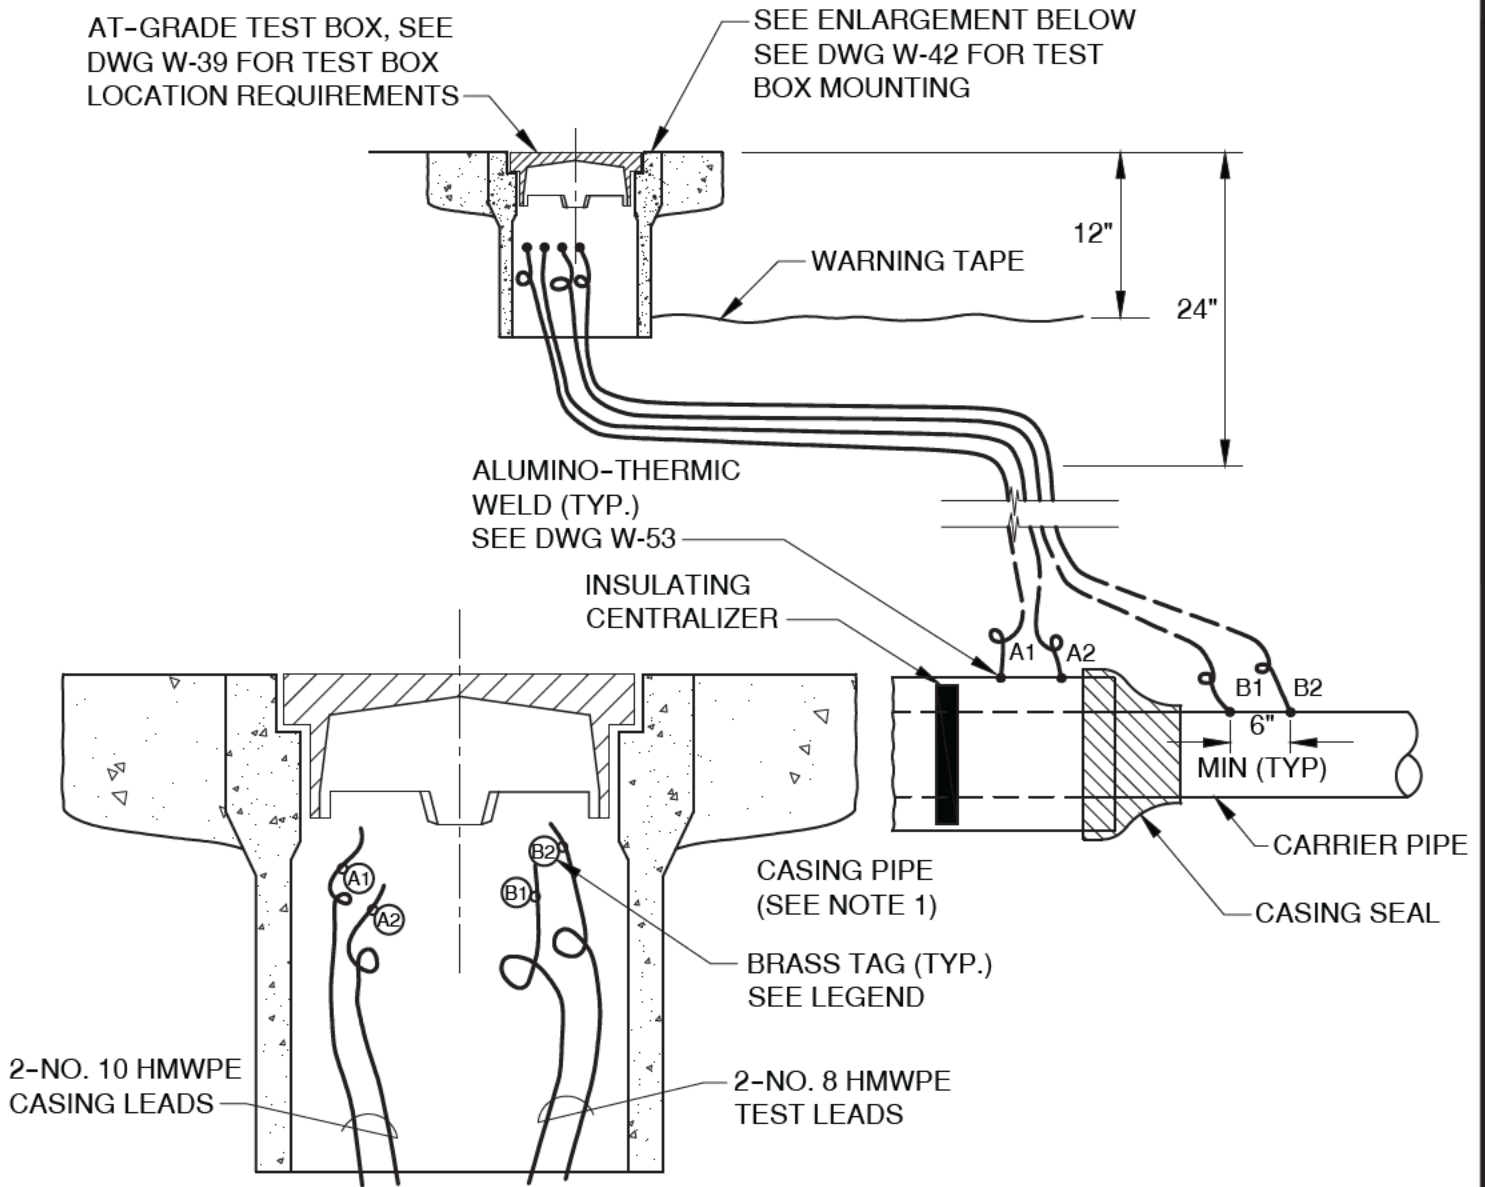

BRASS TAG LEGEND

WIRE	SIZE	ID STAMP
A1	NO. 10	CASING
A2	NO. 10	CASING
B1	NO. 8	VCMWD, SIZE, SERVICE
B2	NO. 8	VCMWD, SIZE, SERVICE

NOTES:

1. ELECTRICAL/METALLIC INSULATION BETWEEN THE CASING AND THE CARRIER PIPE IS REQUIRED.
2. PROVIDE 18" SLACK LOOP IN EACH WIRE AT PIPE/CASING WELD AND IN TEST BOX.

APPROVED:

Wally P. ... 5/16/19

District Engineer Date

5/16/2019

Latest Revision Date



VALLEY CENTER MUNICIPAL WATER DISTRICT
STANDARD DRAWING

4 - WIRE CASING TEST STATION

NOT TO SCALE

DWG. NUMBER

W-45